



21, rue d'Artois, F-75008 PARIS

<http://www.cigre.org>

CIGRE US National Committee 2017 Grid of the Future Symposium

Case Study – Improving System Performance Using Distribution Network Automation

**A. SMITH^{*}, M. WATSON^{*}, J. HAUBER^{*}, C. STUBBS^{*}, B. FLERCHINGER[†],
D. HAES[†], W. ALLEN[†]
Westar Energy^{*}
Schweitzer Engineering Laboratories, Inc.[†]
USA**

SUMMARY

After receiving a U.S. Department of Energy co-funded Smart Grid Investment Grant, Westar Energy implemented an economical and powerful distribution automation (DA) system that includes fully automated fault location, isolation, and service restoration (FLISR) functionality and volt/VAR control. The system described in this paper uses a centralized distribution automation controller (DAC) for automated feeder voltage profile optimization that remains fully functional alongside an FLISR system, which can change the power system topology. Additionally, the DA system provides intelligence and mitigation for miscoordination detection and overload avoidance.

One of the unique aspects of the DA system is that it is able to translate between various communications protocols. It also interfaces with the existing energy management system and integrates some existing Westar legacy equipment with new equipment and controls. Cellular modems and a secure Ethernet gateway provide secure wireless access to the distributed controls throughout the distribution system. Engineers use this remote access along with event collection to improve settings and system operation.

This paper describes the objectives of implementing the new Westar DA system, characteristics and capabilities of the system, system implementation, system performance during real-world events, and implications for future implementations throughout the Westar territory.

KEYWORDS

Distribution automation (DA); distribution network automation; fault location, isolation, and service restoration (FLISR); conservation voltage reduction (CVR); volt/VAR control (V/V) or volt/VAR optimization; system reliability; system efficiency; cybersecurity.

1 INTRODUCTION

In 2010, Westar Energy was awarded a U.S. Department of Energy (DOE) co-funded Smart Grid Investment Grant for the SmartStar Lawrence project. The three-year project consisted of installing advanced metering infrastructure, a meter data management system, and distribution automation (DA). Westar Energy is an investor-owned electric utility founded in 1910 that serves approximately 690,000 customers in the eastern portion of Kansas. The company chose Lawrence, Kansas, as the initial location for implementing this technology because of its size and customer base, which includes many student residents, commercial and industrial customers, and educational institutions.

This paper describes how Westar Energy implemented a cost-effective DA system that is now providing a very capable and fully automated fault location, isolation, and service restoration (FLISR) and volt/VAR distribution solution. The system translates between various communications protocols and interfaces with the existing Westar energy management system (EMS).

The implemented DA system also integrates some existing Westar legacy equipment. Cellular modems were used for communications to the remote intelligent electronic devices (IEDs) because the system was primarily deployed for system restoration and voltage control, which do not require high-speed communications.

While Lawrence customers are the first to benefit from these new capabilities, experiencing fewer outages and a reduction in outage durations, the company plans to install similar equipment throughout its service territory. Application of a centralized distribution automation controller (DAC) and security gateway hardware at Westar Energy has opened the door to the secure, system-wide deployment of communications devices across the entire Westar territory. The DA system was designed to maximize system effectiveness, allow for improved system awareness, and increase work efficiencies across the company, namely as a result of the new remote access capabilities. The SmartStar Lawrence DA project was a success and has provided valuable experience that will be leveraged as Westar Energy continues to expand DA to other parts of their system.

2 DISTRIBUTION AUTOMATION SYSTEM OBJECTIVES

Westar Energy identified the following objectives that they wanted to achieve through implementing a pilot DA system: increase system reliability [1], reduce outage restoration times, minimize distribution system losses, reduce system loading during peak conditions, improve system operation and understanding, and improve service to customers.

To minimize the impact on the distribution system operators, Westar Energy also wanted to pass information from the DA system to the existing EMS so that a separate interface would not be needed. The operators could then use the same system that they were already intimately familiar with operating.

3 PILOT DA SYSTEM

The DA system was implemented on 24 of the 1,227 circuits across the Westar distribution network. The feeder circuits used reclosers at normally open tie points to interconnect two or more power sources. Additional reclosers were installed throughout the feeder circuits to allow sectionalizing capabilities in the event that permanent faults occur on a line section. Figure 1 shows some of the distribution circuits, the interconnection switches, and three different substations that can be used as sources for the feeders.

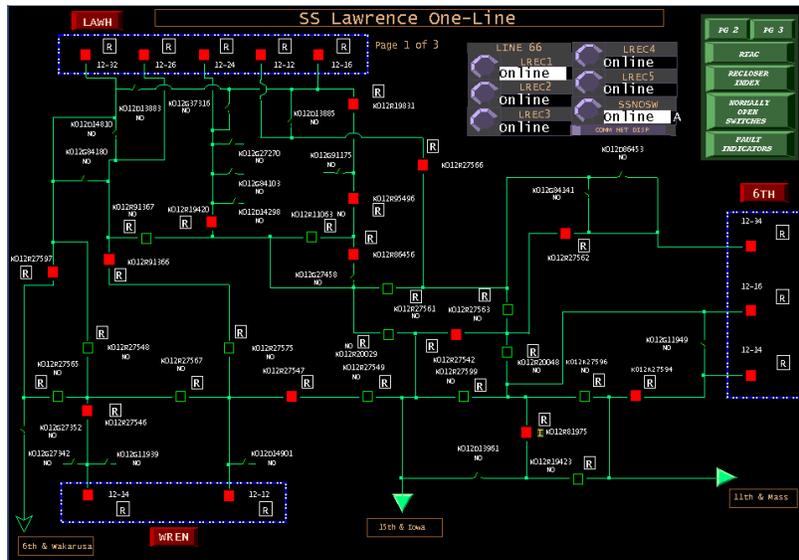


Figure 1 EMS one-line diagram showing normally open (NO) and normally closed (NC) switch points

The equipment used in the DA system included the following:

- Thirty-three new recloser controls and satellite-synchronized clocks paired with the new reclosers.
- One legacy recloser and recloser control.
- Fifty-three capacitor bank controls retrofitted to existing capacitor banks.
- Ten substation transformer load tap changer (LTC) controls (six of which needed to be upgraded).
- Thirty-nine existing nontelemetered switches.
- Eighty-seven 3G and 4G LTE cellular modems for feeder IED communications and control.
- One DAC, providing centralized system intelligence.
- One Ethernet security gateway, providing comprehensive security measures including automated password management of the IEDs.

Leveraging existing communications and controls, the DAC communicates with the substation transformer LTC controls and protective relays via messages transmitted through the EMS to the substation remote terminal units (RTUs). In order to maintain an awareness of the system configuration and of abnormal system operating conditions, a server-based software solution monitors the Westar outage management system (OMS) and provides the status of the nontelemetered switches in the system to the DAC. Whenever operators change the state of the switches in the OMS, this information is also passed to the DAC.

3.1 Protocol Conversion

Several communications protocols were implemented across the DA system, including DNP3, Modbus®, and other open protocols. The protocols were selected either because of legacy equipment limitations or to provide the desired IED functionality. In turn, the DAC acts as a multiprotocol interface to all of the IEDs, allowing them to participate as peers in a unified, holistic system. Additionally, the DAC provides port routing functionality for remote access capabilities using various proprietary software interfaces. This allows a mix of new and legacy IEDs as well as controllers from different equipment manufacturers to be used, thus minimizing the installation time and the cost associated with implementing the system.

3.2 Wireless Communications

Westar Energy chose to leverage cellular technology for a number of reasons. Because the automation system was primarily deployed for system restoration and voltage control, high-speed communications were not required. All protection functions are performed locally within the IEDs, so the loss of communications is acceptable, although not desirable. It was also recognized that the design,

deployment, and maintainability of a company-owned communications system would require a significant capital investment and would result in long-term operation and maintenance expenses. However, there would be the advantage of no recurring carrier charges. This type of deployment would also stress the technical workforce at Westar Energy, both in the present and in the future. Planned obsolescence would also need to be factored into the system and would require another capital-intensive system upgrade of the communications network in the future. Moreover, performance of cellular communications has been evaluated by Westar Energy and others (refer to [2]) and was found to be adequate for the new DA system.

The initial setup of the cellular modems and antennas proved to be a challenge. However, making an adjustment to the antenna placement by moving each antenna from underneath the control cabinet to a mounting bracket higher on the pole improved the quality of cellular service. The initial Ethernet and serial settings for the modems also took some time to troubleshoot, and time was needed to develop standardized settings for various IEDs. The DA engineers worked closely with the Westar information technology (IT) groups and the cellular network providers to configure the communications backhaul properly.

Cellular communications allowed Westar Energy to minimize deployment times because there was no back-end infrastructure to build and maintain. Although there were ongoing data charges, data rate plans were negotiated with the cellular providers, which offset the costs that would have been associated with a company-owned system. Other benefits are that the cellular network is continually being built to incorporate new technologies that increase data throughput rates and decrease costs of data plans. Westar Energy is confident that the move to cellular technology was the correct decision.

Another critical aspect of successfully implementing the communications system for the DA system was that the DA engineers worked with the IT groups, including IT security, when designing and implementing the system. Through a collaborative effort, a secure communications system was implemented using cellular as well as serial and Ethernet communications.

4 DA SYSTEM IMPLEMENTATION

Westar Energy implemented the DA system in two phases, starting with the FLISR capability (Phase 1) and then adding volt/VAR control capability (Phase 2). This method allowed the reclosers to be installed initially (see Figure 2), later followed by the replacement of capacitor bank controls and LTC integration. The initial DAC programming was provided by the DAC manufacturer. FLISR and volt/VAR programming were included by creating a system model and configuring standard DA libraries for the Westar distribution system. Human-machine interface (HMI) displays were also developed for use during commissioning and testing.

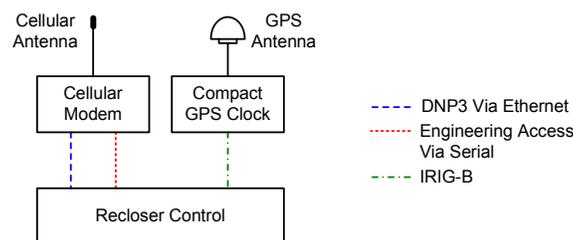


Figure 2 Typical recloser cabinet with a Global Positioning System (GPS) satellite clock and a 3G or 4G LTE cellular modem

Remote interactive training was provided so that engineers at Westar Energy would be proficient at maintaining and implementing changes to the system to accommodate additional IEDs or feeder circuits in the future. Westar engineers further developed and implemented features in the system to aid with routine system monitoring and operations, including the deployment of automated password management, remote IED management capabilities, automated Short Message Service (SMS) and email routines, and additional HMIs. Additionally, the involvement of operations groups in the implementation and the provision of training were essential to operator understanding and acceptance of autonomous, closed-loop system operation.

5 DA SYSTEM CAPABILITIES

5.1 FLISR Capabilities

The Phase 1 portion of implementing the Westar DA system provided centralized automated controls that perform autonomous FLISR activities. The DAC provided the following features as part of the FLISR functionality:

- Loss-of-source detection.
- Open-phase detection.
- Miscoordination detection and mitigation, which provides operator notification and sectionalizes the correct portion of the system with the fault.
- Overload mitigation and load shedding, which smartly selects an alternate source with available capacity, shifts sources if loading increases beyond the limits, or sheds load if no alternate sources with capacity are available.

5.2 Volt/VAR Capabilities

In Phase 2, automation and control for voltage and reactive power flow were implemented. Example results are shown in Figure 3. Volt/VAR control can be used to achieve several different goals, as discussed in [3]. The Phase 2 implementation used the same centralized system DAC and feeder information as Phase 1, but it added control of voltage regulators, capacitor banks, and substation transformer LTC controls to the system model. This simplified the effort of adding volt/VAR control while allowing both capabilities to operate as an integrated system. A benefit of implementing the system in this manner was that even after system reconfiguration, volt/VAR capabilities can still be performed on the reconfigured system, as described in [4].

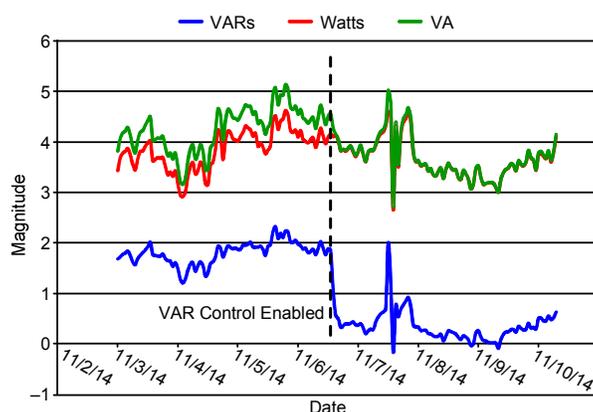


Figure 3 Results of an automated capacitor bank control on one of the feeders

Volt/VAR features provided by the DAC included the following:

- Minimized VAR flow (i.e., system losses).
- Flattened voltage profile across feeders, allowing for feeder voltage reductions while not exceeding the minimum voltage limits to end-use customers.
- Feeder voltage reductions, which resulted in reduced energy consumption during peak demand (dependent on load characteristics). This is also known as conservation voltage reduction (CVR).
- Flexible operator control modes, which optimize voltage on the feeder, optimize power factor (PF) on the feeder, optimize PF on the substation bus, demand response for peak load reduction, and optimize the VAR set point on the primary side of the transformer for transmission VAR support.

5.3 Remote Engineering Access

A benefit of having secure communications to the substation and feeder devices is that it enables remote engineering access. Engineers are now able to retrieve and change IED settings as well as pull event data (Sequential Event Recorder [SER] reports and oscillography) from devices on a feeder

circuit. This facilitates faster event analysis as well as helps to refine settings for improved system operation and protection. Westar Energy has also implemented automated password management using the secure Ethernet gateway to facilitate changing passwords in accordance with North American Electric Reliability Corporation Critical Infrastructure Protection (NERC CIP) requirements. Automated password management allows complex passwords to be changed in all of the remote IEDs periodically or on demand as required. Lastly, the DAC was configured with automated SMS text and email messaging routines for configured alarms and events, alerting operators or engineers to system issues that require attention.

6 THE DA SYSTEM IN ACTION

On November 10, 2014, a failed ground wire located on the primary line between the substation breaker and the first downstream recloser failed and caused the circuit to lockout. The DAC opened the first recloser to isolate the fault and closed a normally open recloser to pick up 894 customers from an alternate feeder source in less than two minutes. In addition, the DA system has been used to identify a sympathetic fault on a feeder in the automation scheme. As a result of the remote data collection capabilities provided by the system, Westar engineers were able to identify a location upstream of a faulted line section where conductors were slapping together on account of the magnetic fields associated with high fault current levels. It is believed that similar intelligence can be designed into the system so that this process of fault identification can be automated in the coming years.

Another benefit that has been realized by the addition of reclosers and recloser controls to the DA system is the reduction in customer interruptions, even without FLISR system interaction. As of November 2014, the reclosers have eliminated approximately 333,000 customer minutes interrupted (CMI).

Additionally, by using the centralized DAC for volt/VAR control along with the capacitor banks spread throughout the Westar system, the voltage profile along feeders has been flattened, improving the power quality delivered to customers as well as reducing energy consumption.

CONCLUSION

The Lawrence area is already realizing the benefits of the new Westar DA system, which is improving reliability and power quality for customers. The system provides FLISR functionality as well as automation and control for voltage and reactive power flow. It also provides some powerful, advanced features like miscoordination detection and mitigation as well as volt/VAR control even when the system has been reconfigured.

Because the DAC uses industry-standard protocols and because existing and new equipment controls could be integrated and used together, the installation time and costs associated with the project were reduced. Furthermore, using these same standard protocols enabled the DA system to interface with the existing EMS and OMS, helping the operators become more comfortable with the new system.

Westar Energy used 3G and 4G cellular communications to implement control and access to the remote devices. By using cellular communications, Westar Energy was able to leverage the available infrastructure and cellular modems without having to install their own wireless system. This reduced their upfront costs and allowed for faster deployment of the system. Adding a secure Ethernet gateway to the system provided additional security because it allows for virtual private network (VPN) access and password management for all of their remote IEDs.

The new Westar DA system is reducing operating costs and improving system reliability and operating efficiency, all while improving customer satisfaction. This provides a win-win solution for both Westar Energy and their customers. Westar Energy plans to expand their use of DA based on this highly successful pilot system.

ACKNOWLEDGMENT

This material is based upon work supported by the Department of Energy under Award Number DE-OE0000275.

Disclaimer: This report was prepared as an account of work sponsored by an agency of the United States Government. Neither the United States Government nor any agency thereof, nor any of their employees, makes any warranty, express or implied, or assumes any legal liability or responsibility for the accuracy, completeness, or usefulness of any information, apparatus, product, or process disclosed, or represents that its use would not infringe privately owned rights. Reference herein to any specific commercial product, process, or service by trade name, trademark, manufacturer, or otherwise does not necessarily constitute or imply its endorsement, recommendation, or favoring by the United States Government or any agency thereof. The views and opinions of authors expressed herein do not necessarily state or reflect those of the United States Government or any agency thereof.

BIBLIOGRAPHY

- [1] IEEE Standard 1366-2012, IEEE Guide for Electric Power Distribution Reliability Indices.
- [2] R. Ferraro, C. Steeprow, M. Mills-Price, B. Flerchinger, and J. Knapek, "Private Versus Cellular Network Performance for Synchrophasor Data Collection: A Portland General Electric Case Study," proceedings of UTC Telecom 2014, Phoenix, AZ, May 2014.
- [3] E. T. Jauch, "Volt/VAR Management – An Essential 'SMART' Function," proceedings of the IEEE/PES Power Systems Conference and Exposition, Seattle, WA, March 2009.
- [4] M. Feller, B. Fazzari, R. Van Singel, and W. C. Edwards Jr., "Case Study: Using Distribution Automation to Build the Next Generation Utility in the City of Wadsworth," proceedings of the 67th Annual Conference for Protective Relay Engineers, College Station, TX, April 2014.